




TEE BRANCH (external sides flushed)

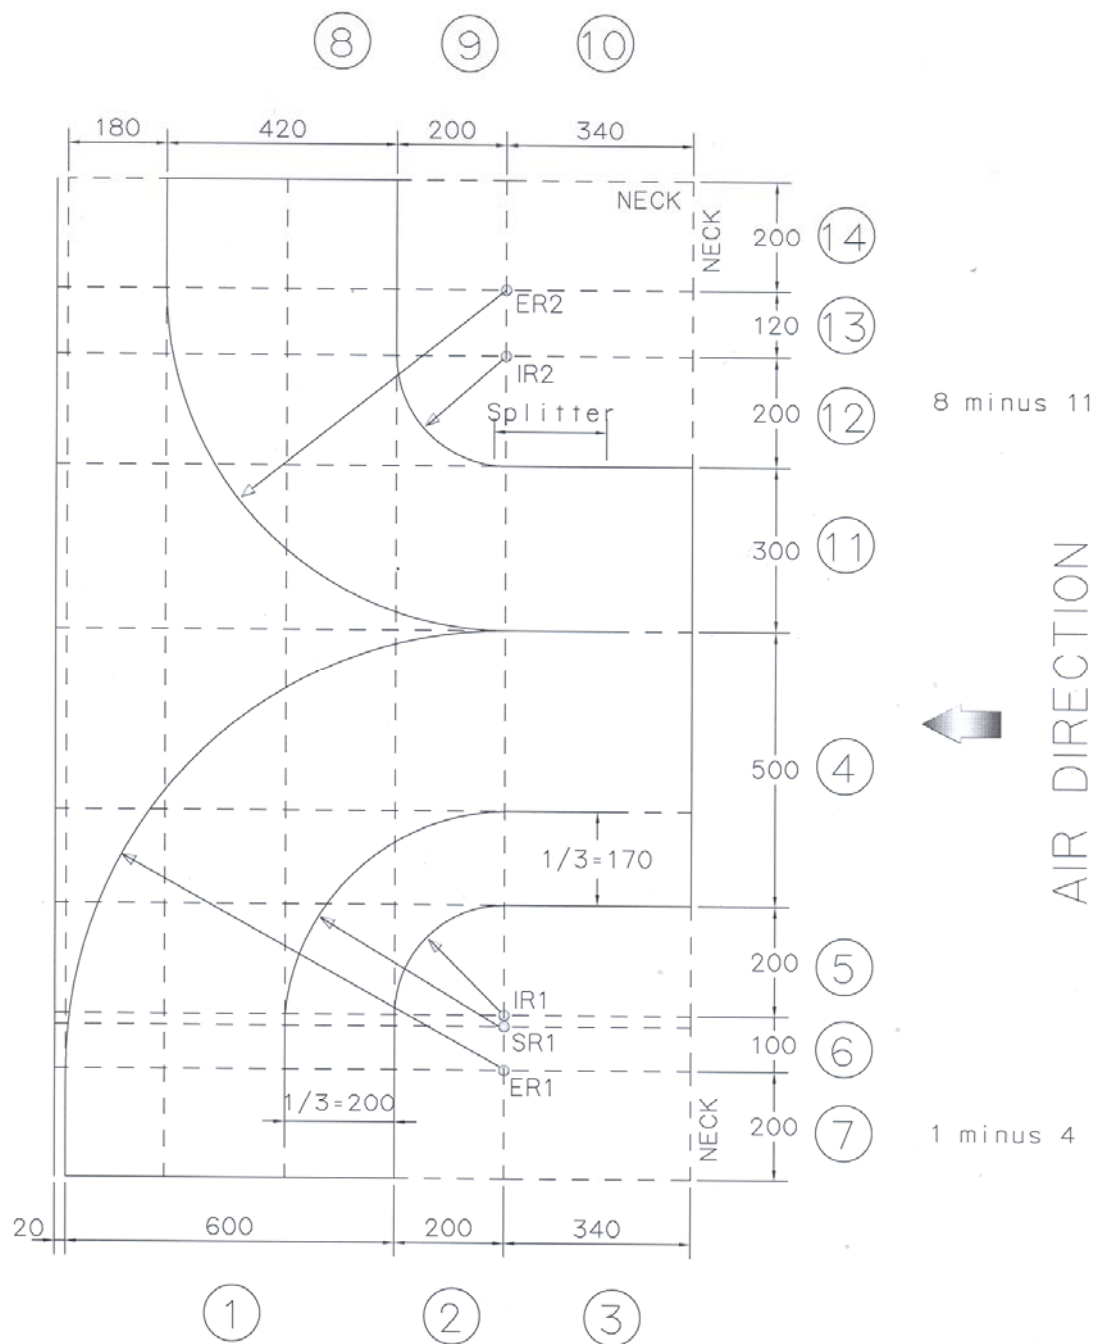


SPLITTER DAMPER

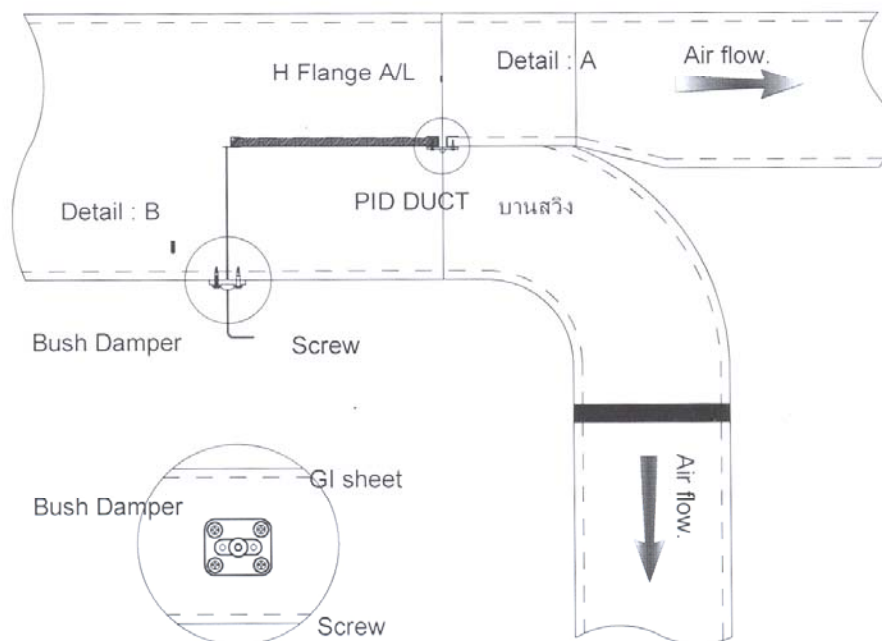


Detail : B

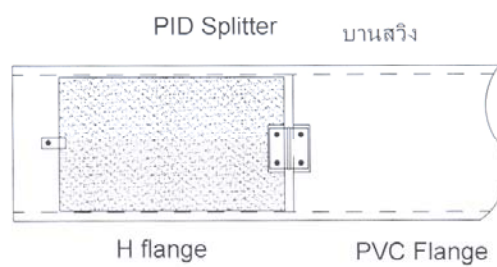


PID REINFORCEMENT SYSTEM IN ALUMINIUM

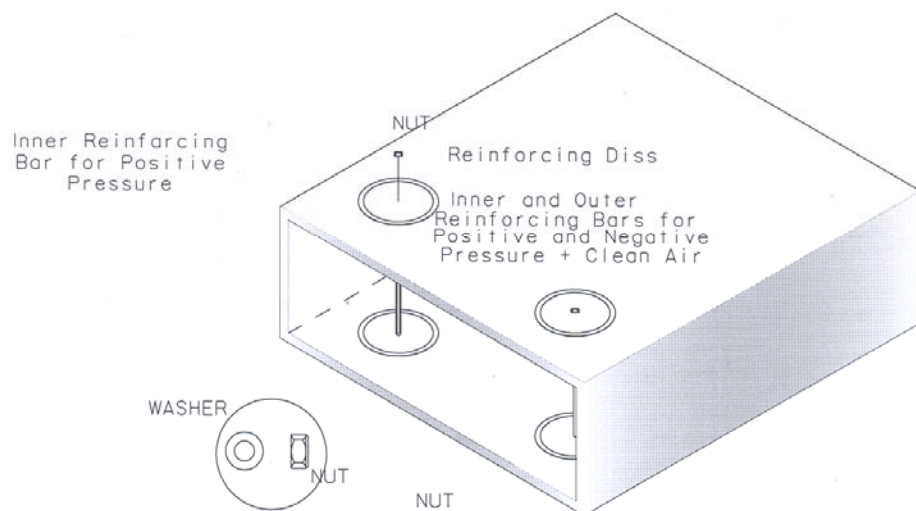

TIGER CONNECTOR APPLICATION FOR PID DUCT SIZE < 500 mm.

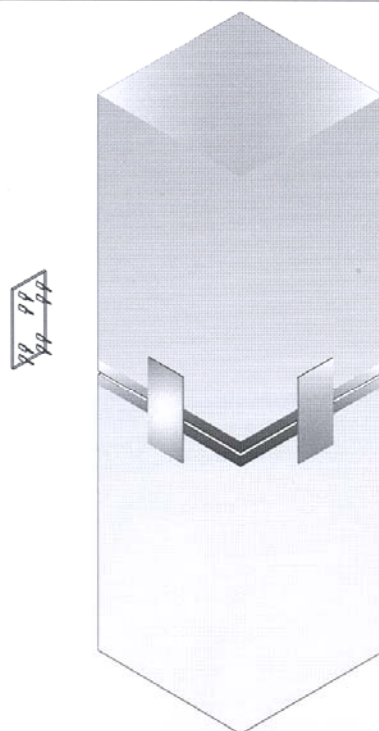

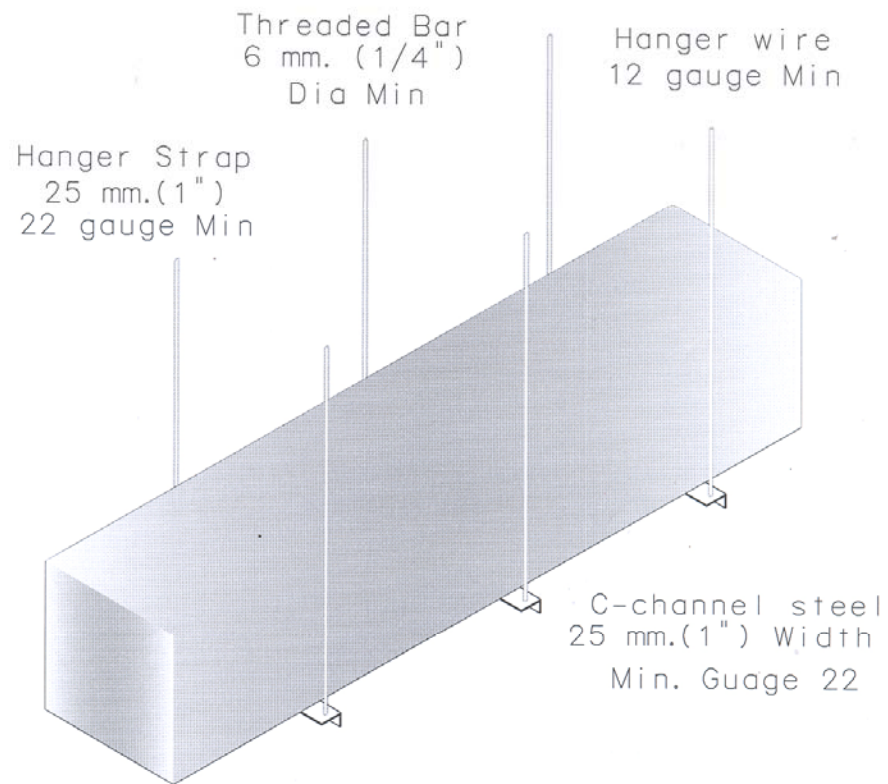


Hanger Spacing

4000 mm. Segment	4000 mm. (13 ft) max		N/A
1200 mm. Segment	2400 mm. (8 ft) max	1800 mm. (6 ft) max	1200 mm. (4 ft) max

แบบที่ 1


COLLAR CONNECTION

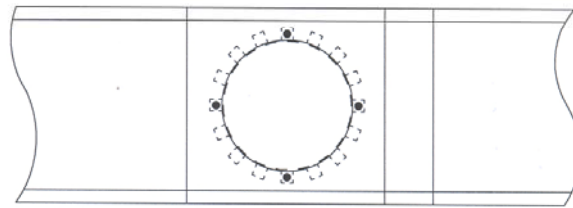

Front View

Screw # 7x4

PID Duct

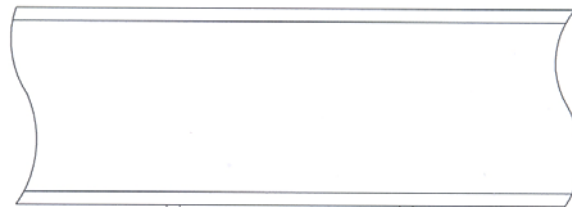

Screw # 7x4




Silicon


GLUE
& Silicone
PVC OR Galvanize Washer

GALVANIZED


Top View

PVC FLANGE & BAYONET CONNECTION
FOR PID DUCT SIZE > 500 mm.

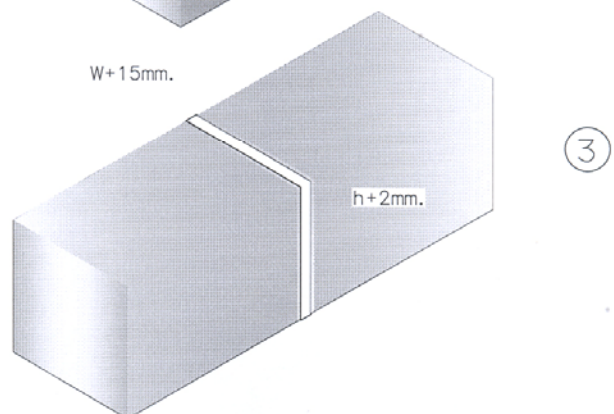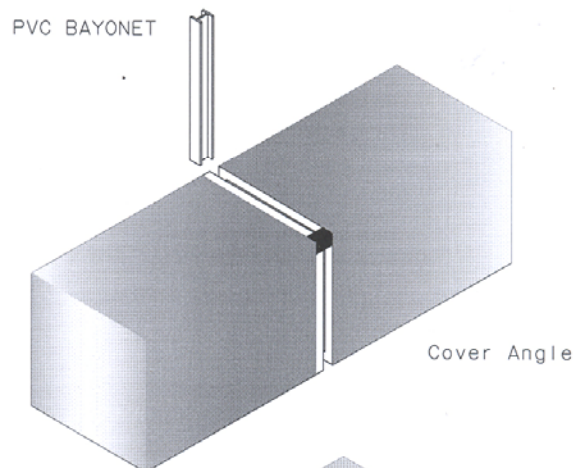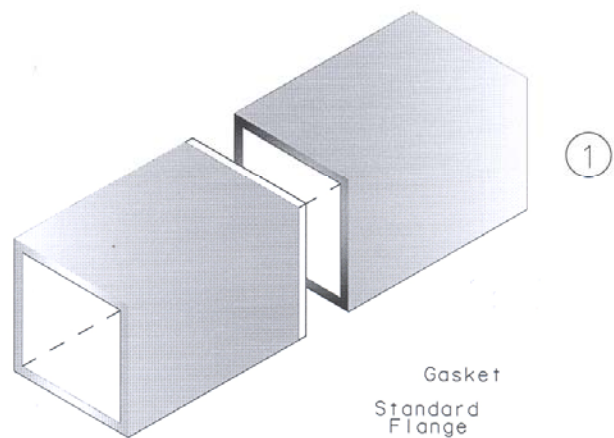

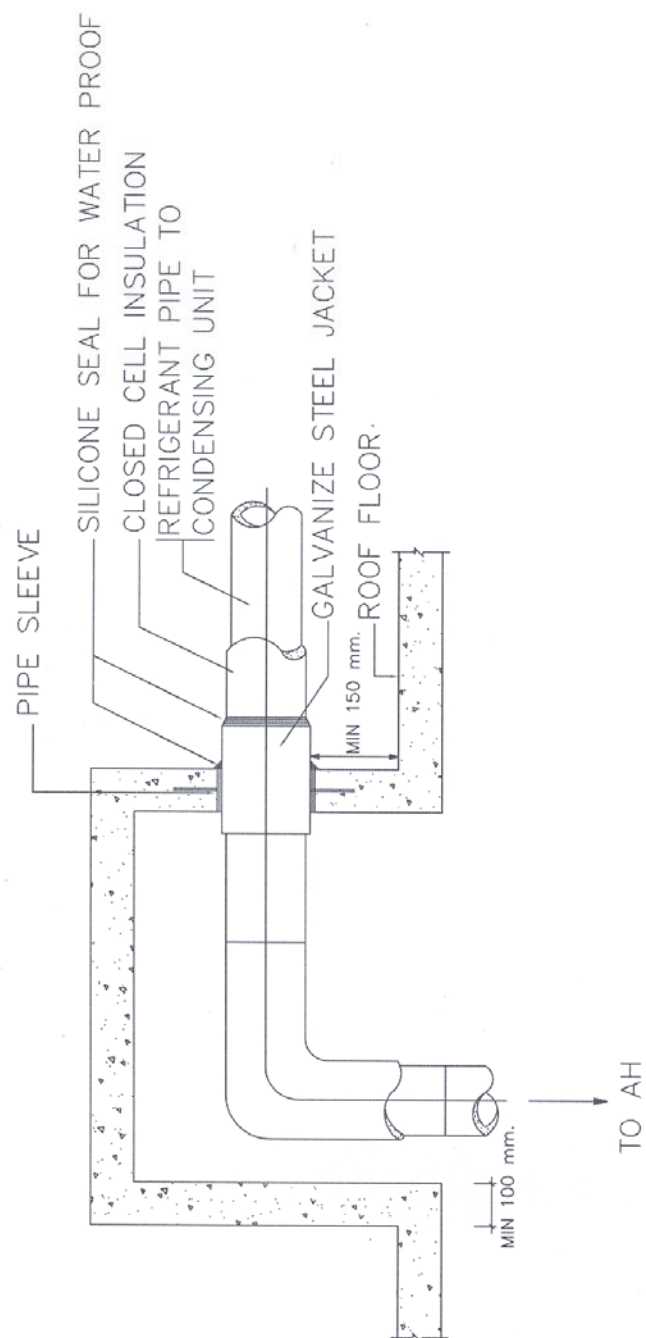


REFRIGERANT PIPE THRU ROOF

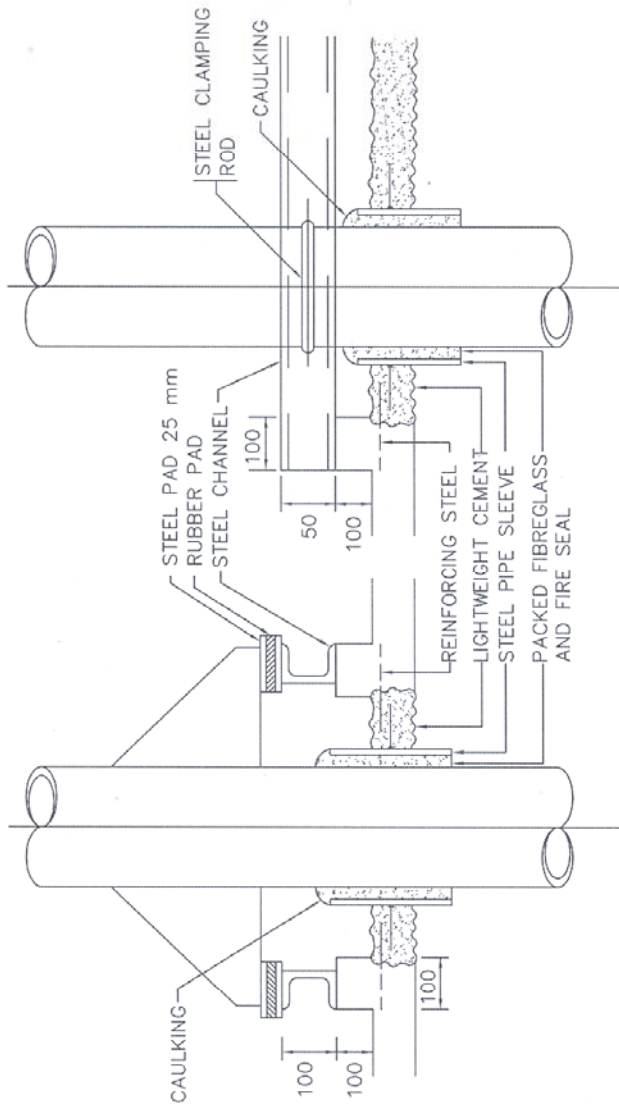


SECTION

SECTION

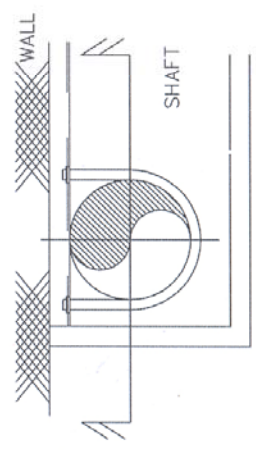


PLAN

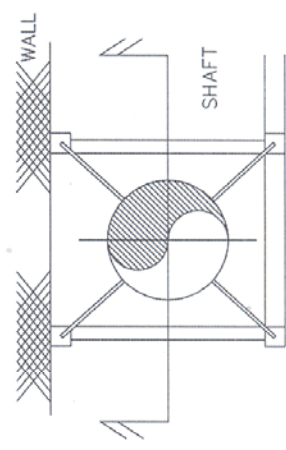


PLAN

PIPE PASS THRU SHAFT


DPW12

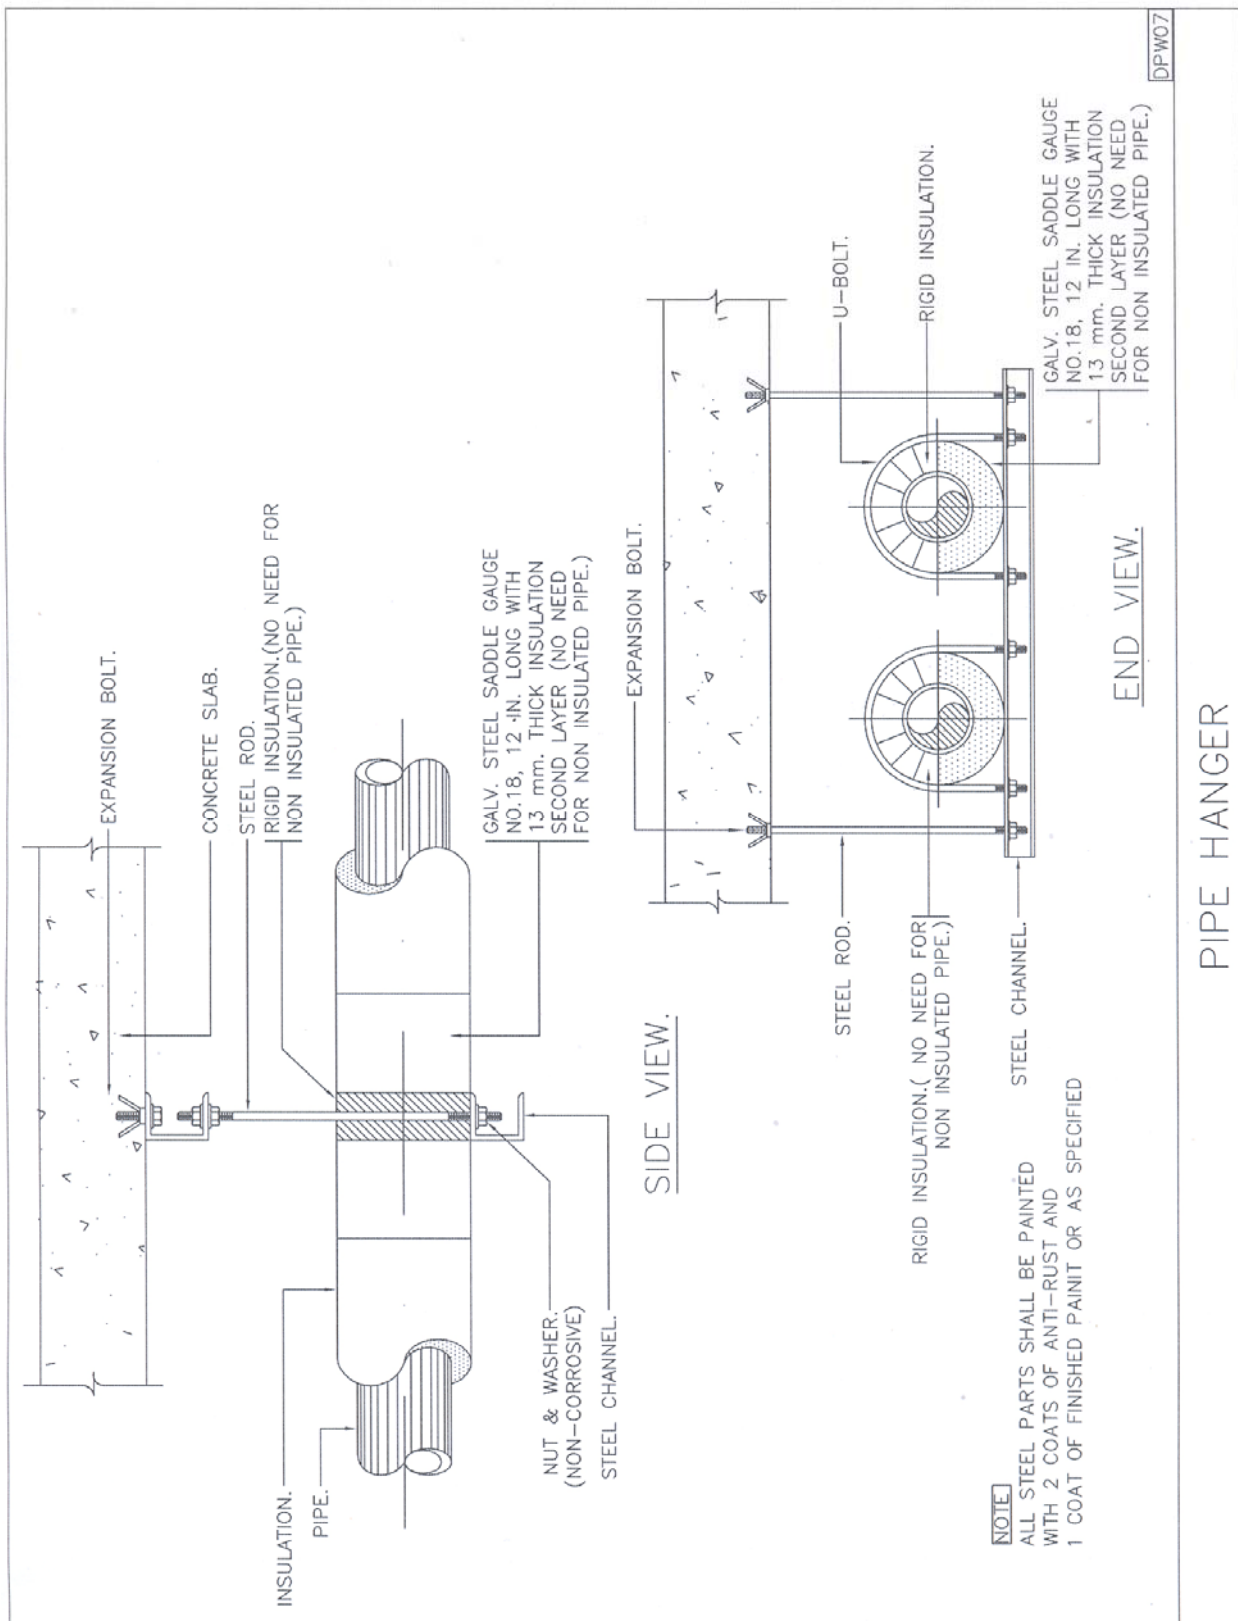

PIPE HANGER

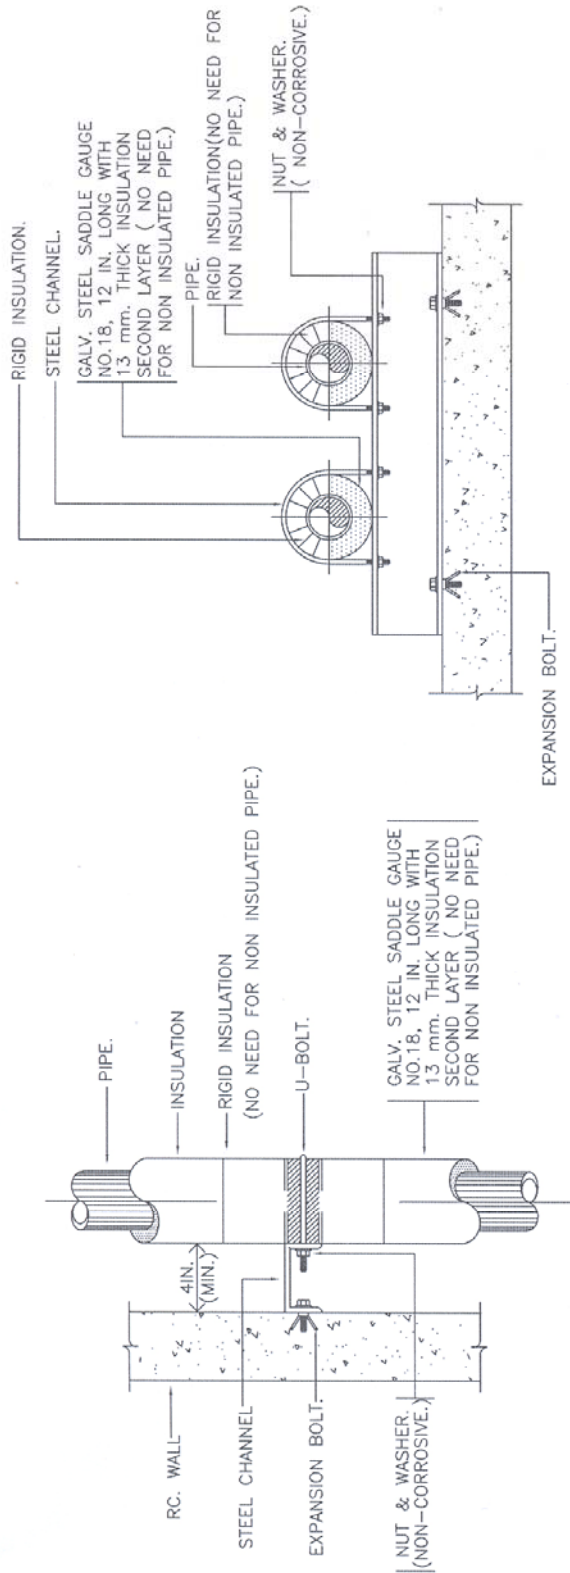


ELEVATION WALL

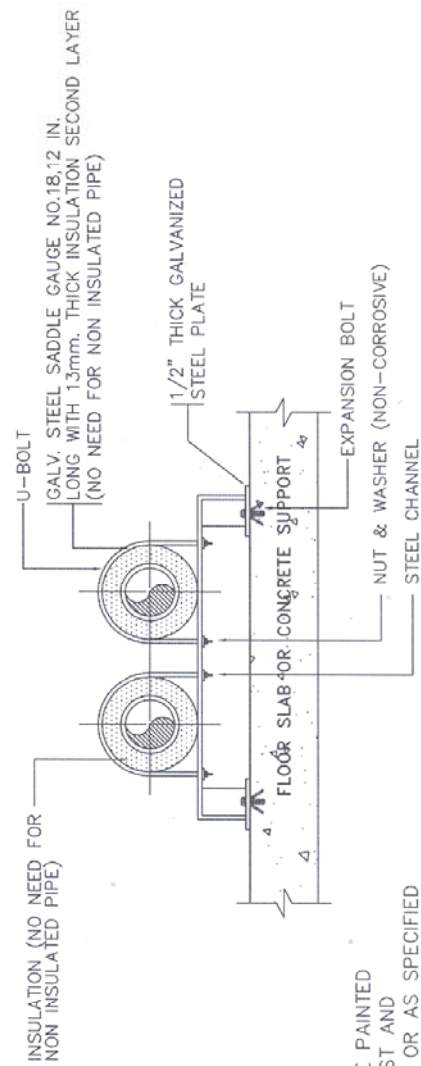


NOTE
ALL STEEL PARTS SHALL BE PAINTED
WITH 2 COATS OF ANTI-RUST AND
1 COAT OF FINISHED PAINT OR AS SPECIFIED

ELEVATION FLOOR


PIPE SUPPORT TO WALL & FLOOR

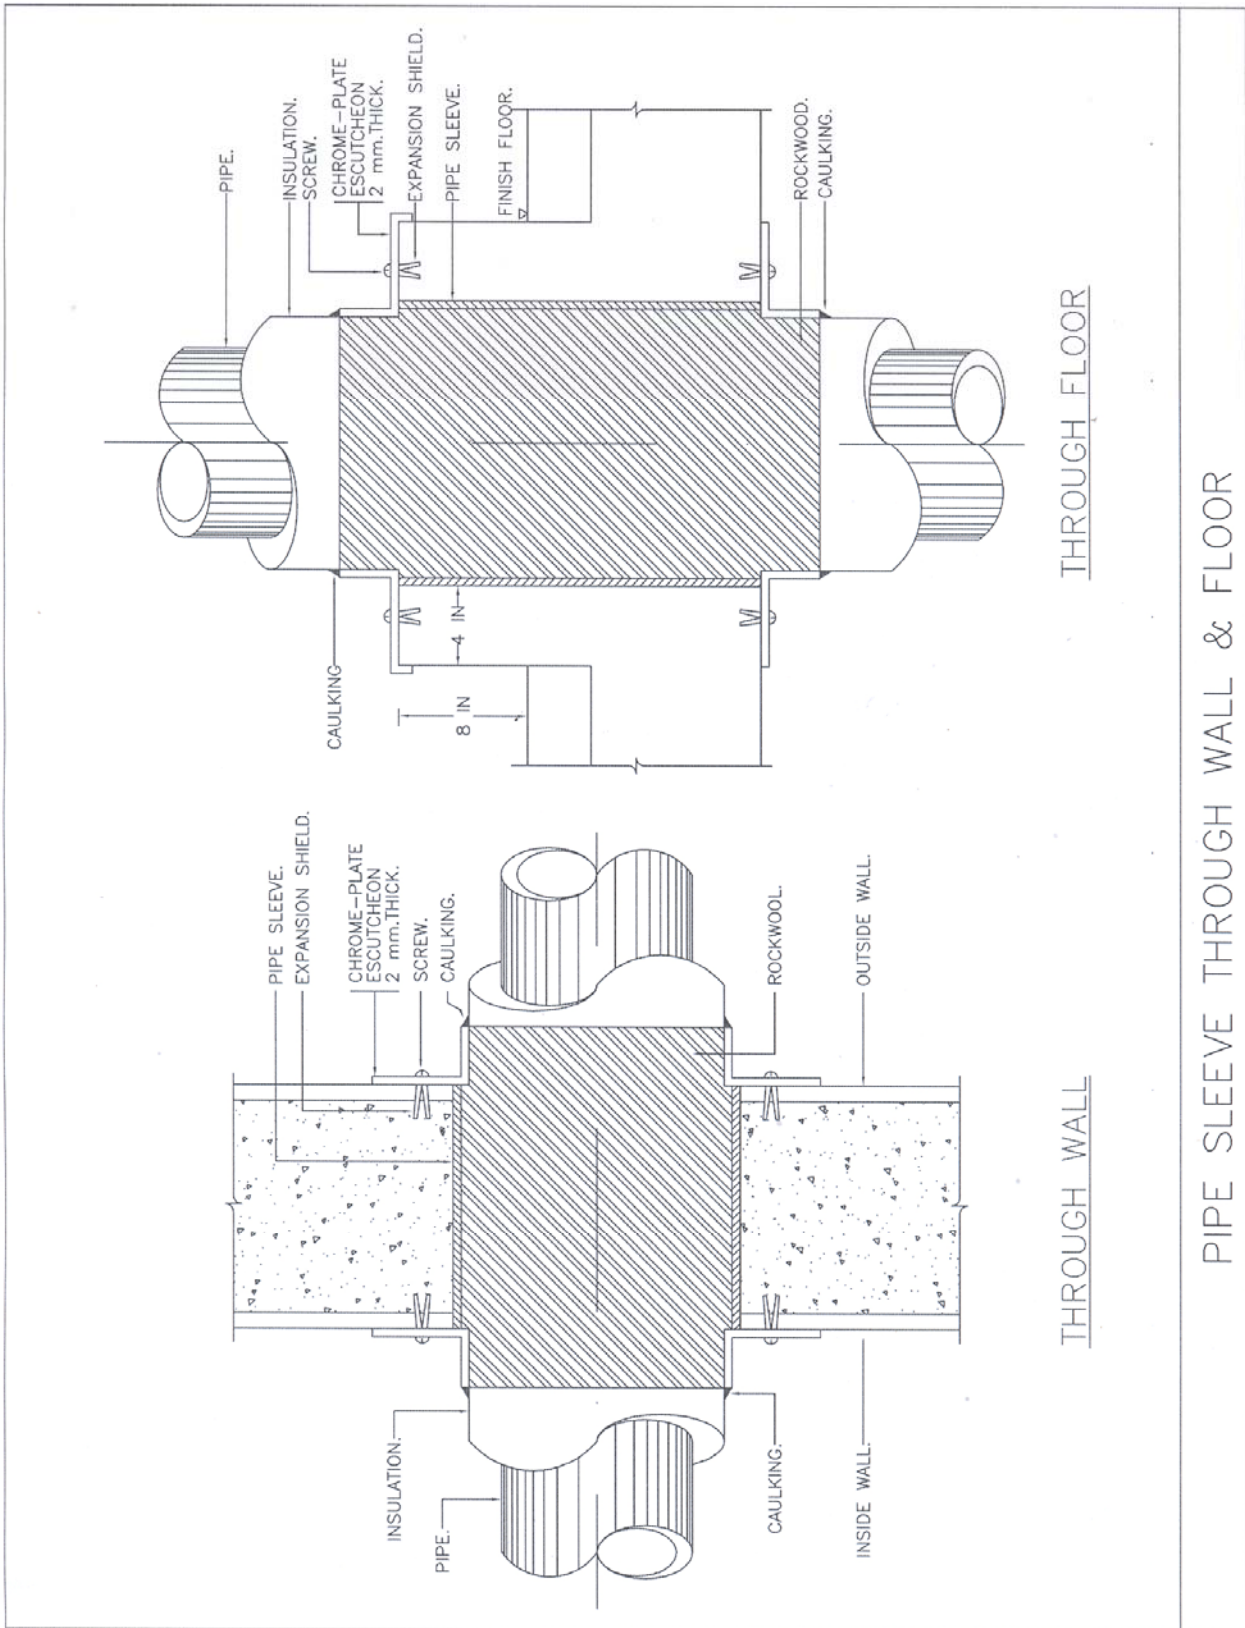

PIPE SLEEVE THROUGH WALL & FLOOR

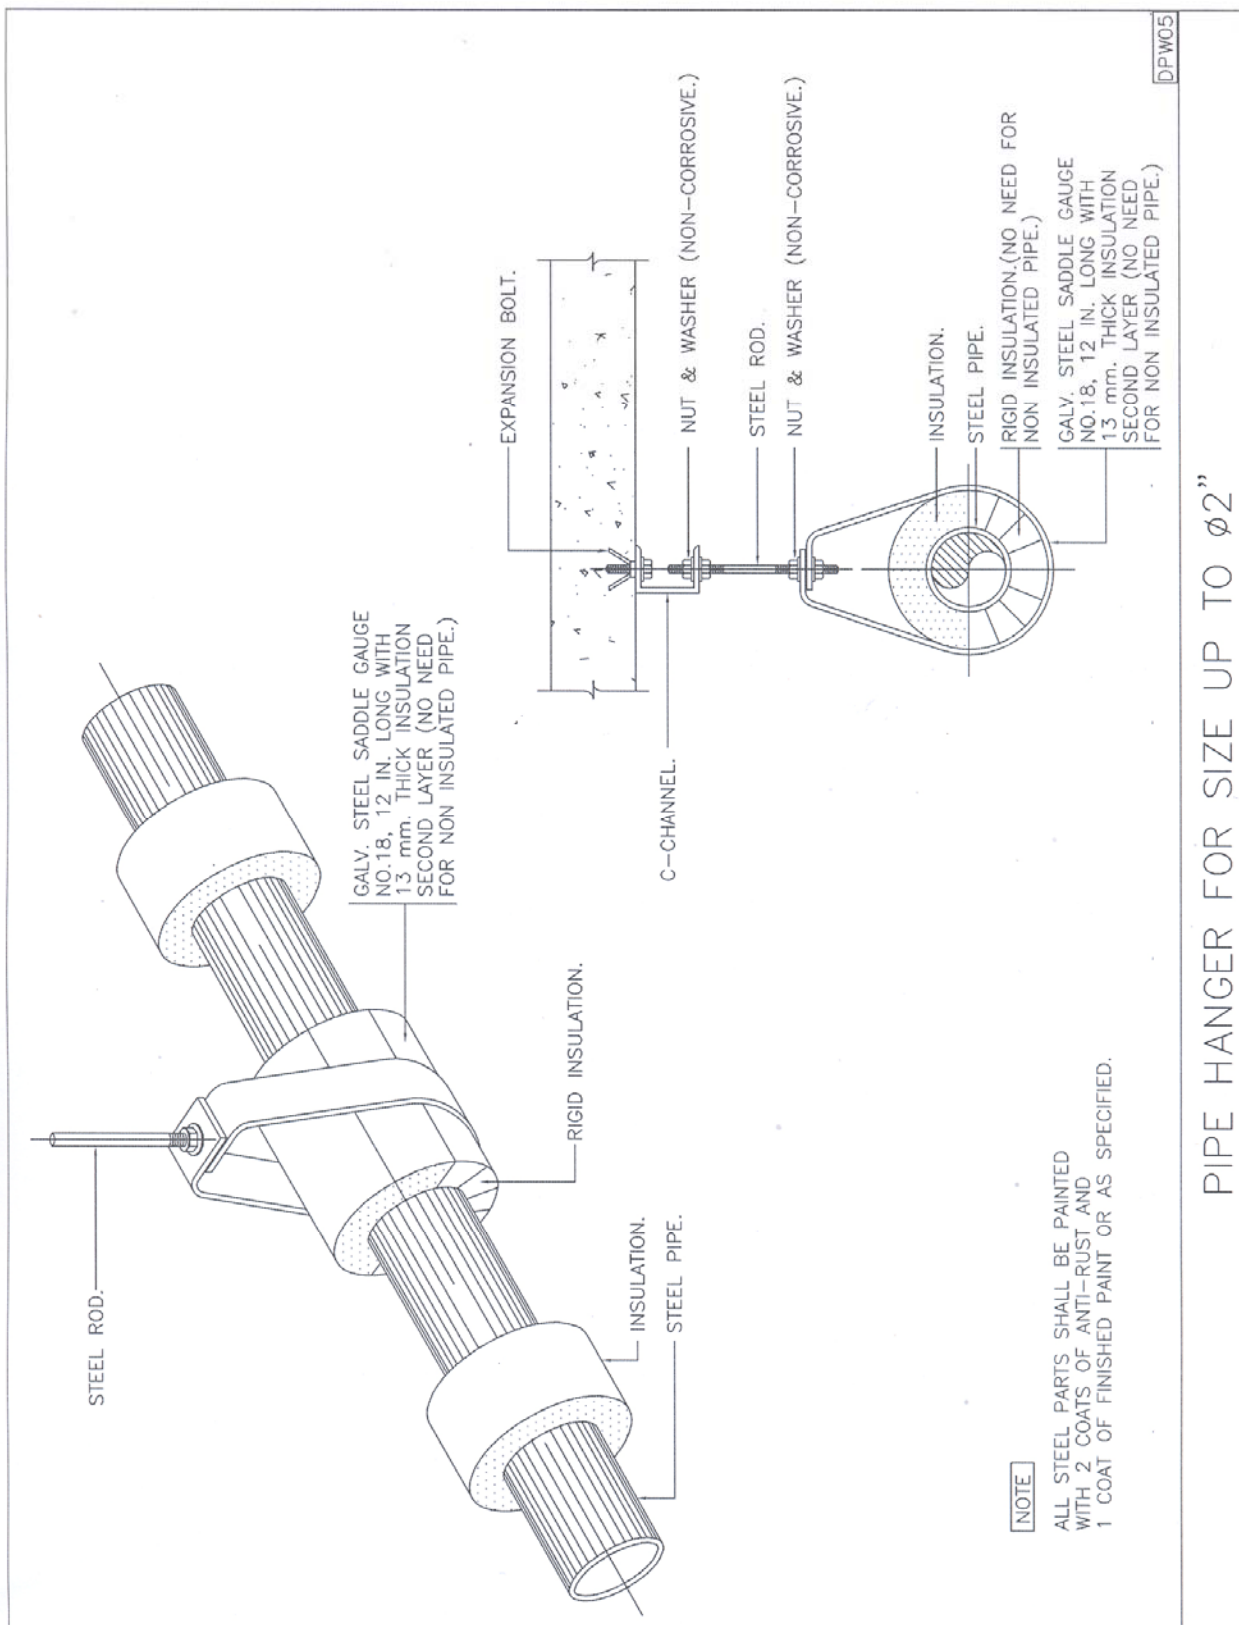


PIPE HANGER FOR SIZE UP TO $\phi 2$ "

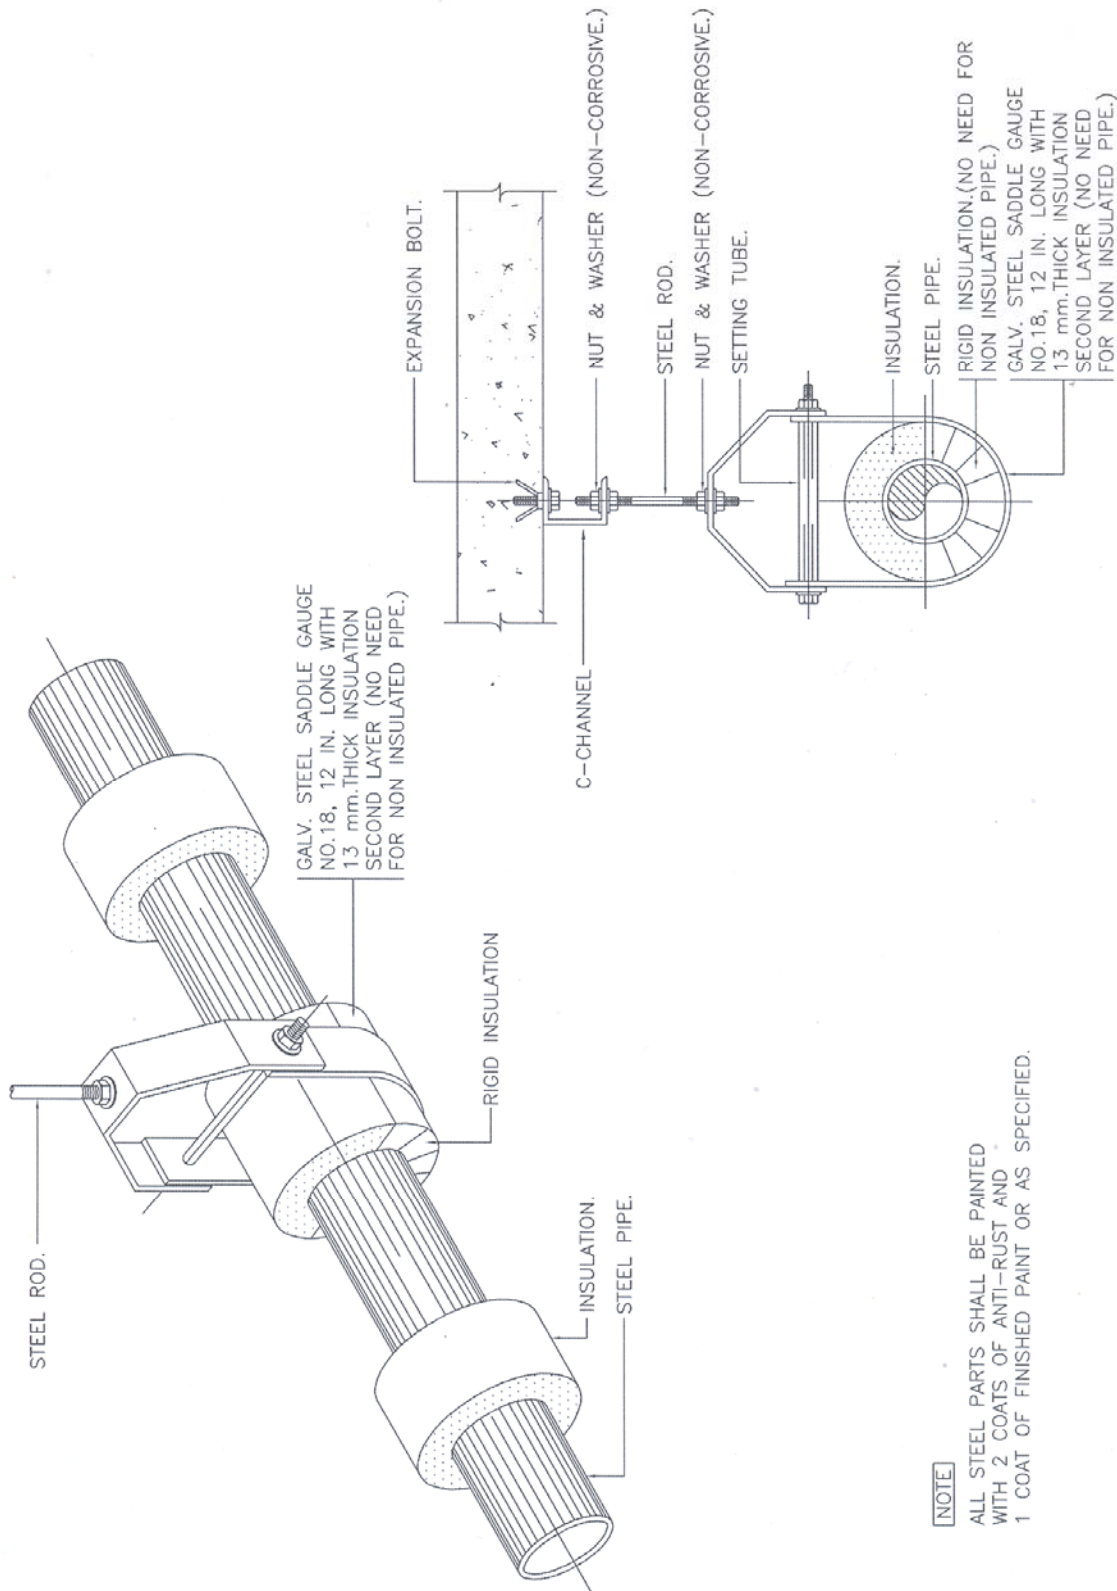


DPW06

PIPE HANGER FOR SIZE $\phi 2 \frac{1}{2}$ " AND LARGER

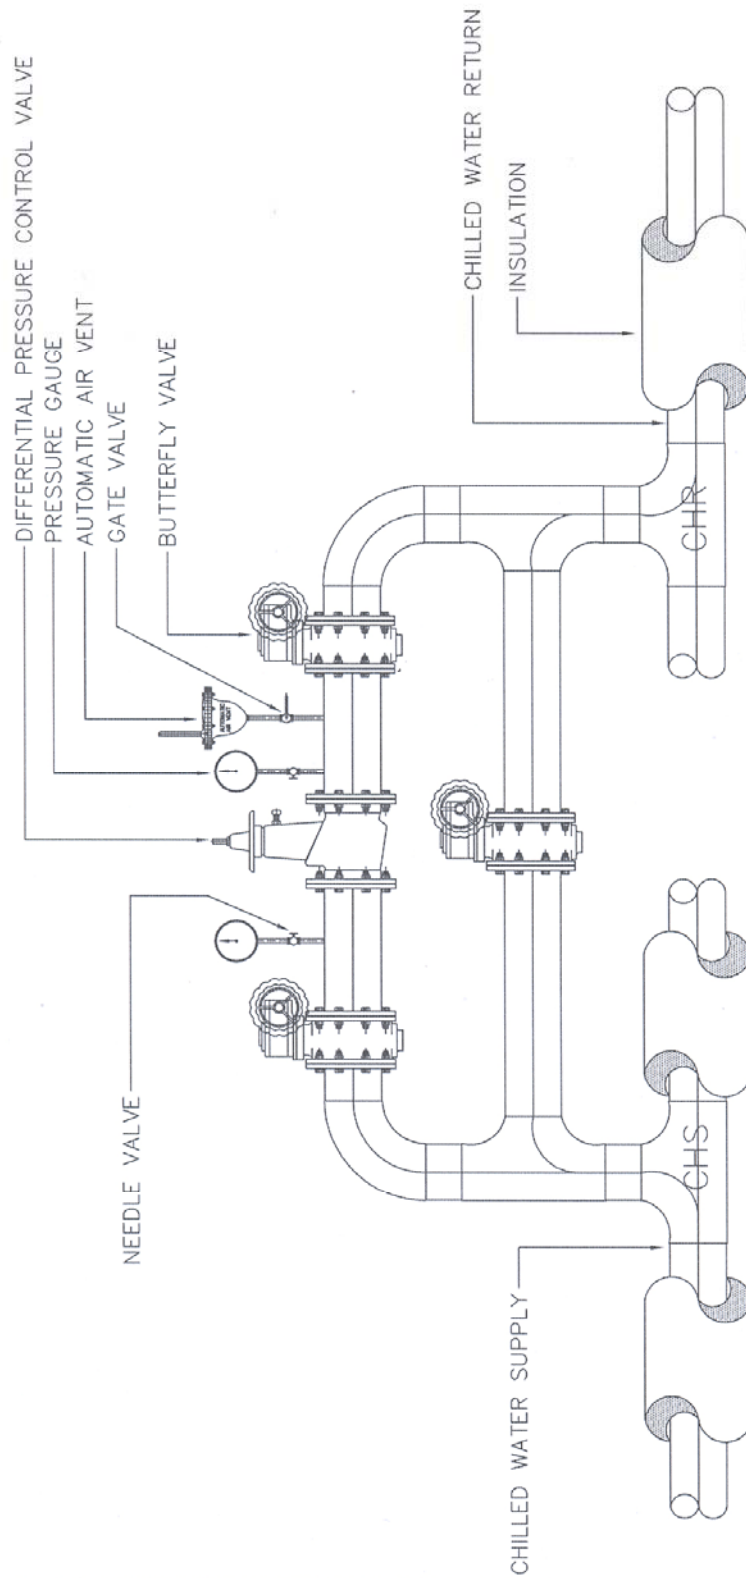

DPWT5



DIFFERENTIAL PRESSURE CONTROL VALVE PIPING DETAIL.

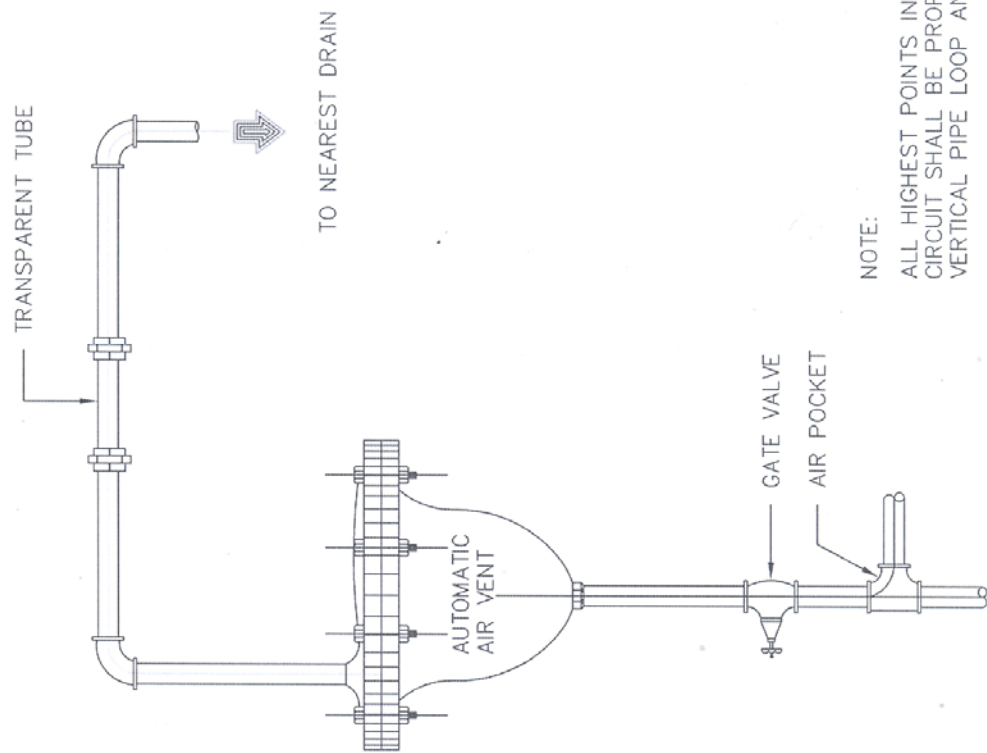

NOTE:
ALL HIGHEST POINTS IN THE PIPING
CIRCUIT SHALL BE PROPERLY VENTED TO
VERTICAL PIPE LOOP AND TOP PIPE RISERS.

DPW16

AUTOMATIC AIR VENT PIPING DETAIL.

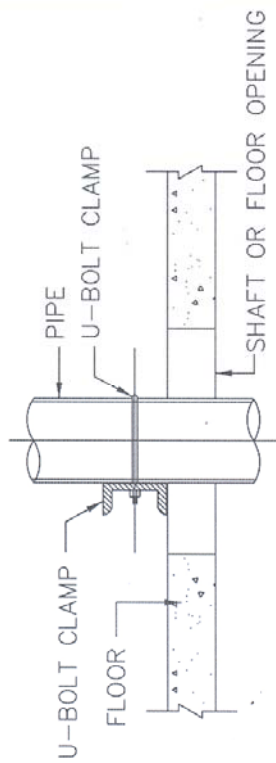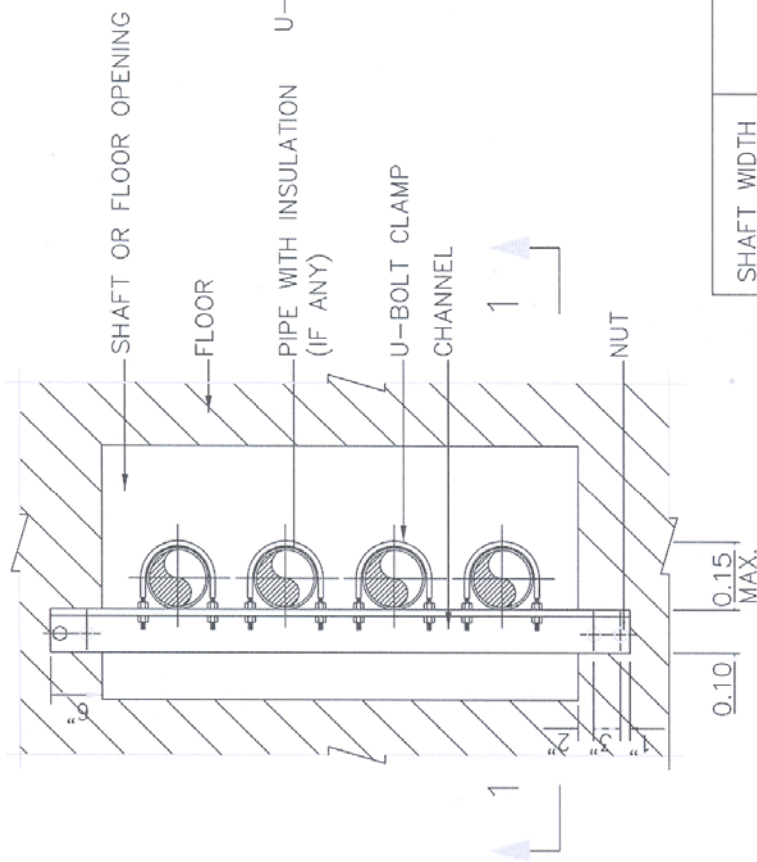



SECTION 1-1

SHAFT WIDTH CM.	C-CHANNEL	U-BOLT CLAMP FOR PIPE DIA.		
		$\phi 1/2'' - \phi 2 \ 1/2''$	$\phi 3'' - \phi 6''$	$\phi 8'' - \phi 14''$
<60	4" x 2" x 2 1/2"	3/8"	1/2"	5/8"
60-90	6" x 3" x 3 1/8"			

DPW22

PIPE RUN IN OPEN SHAFT DETAIL

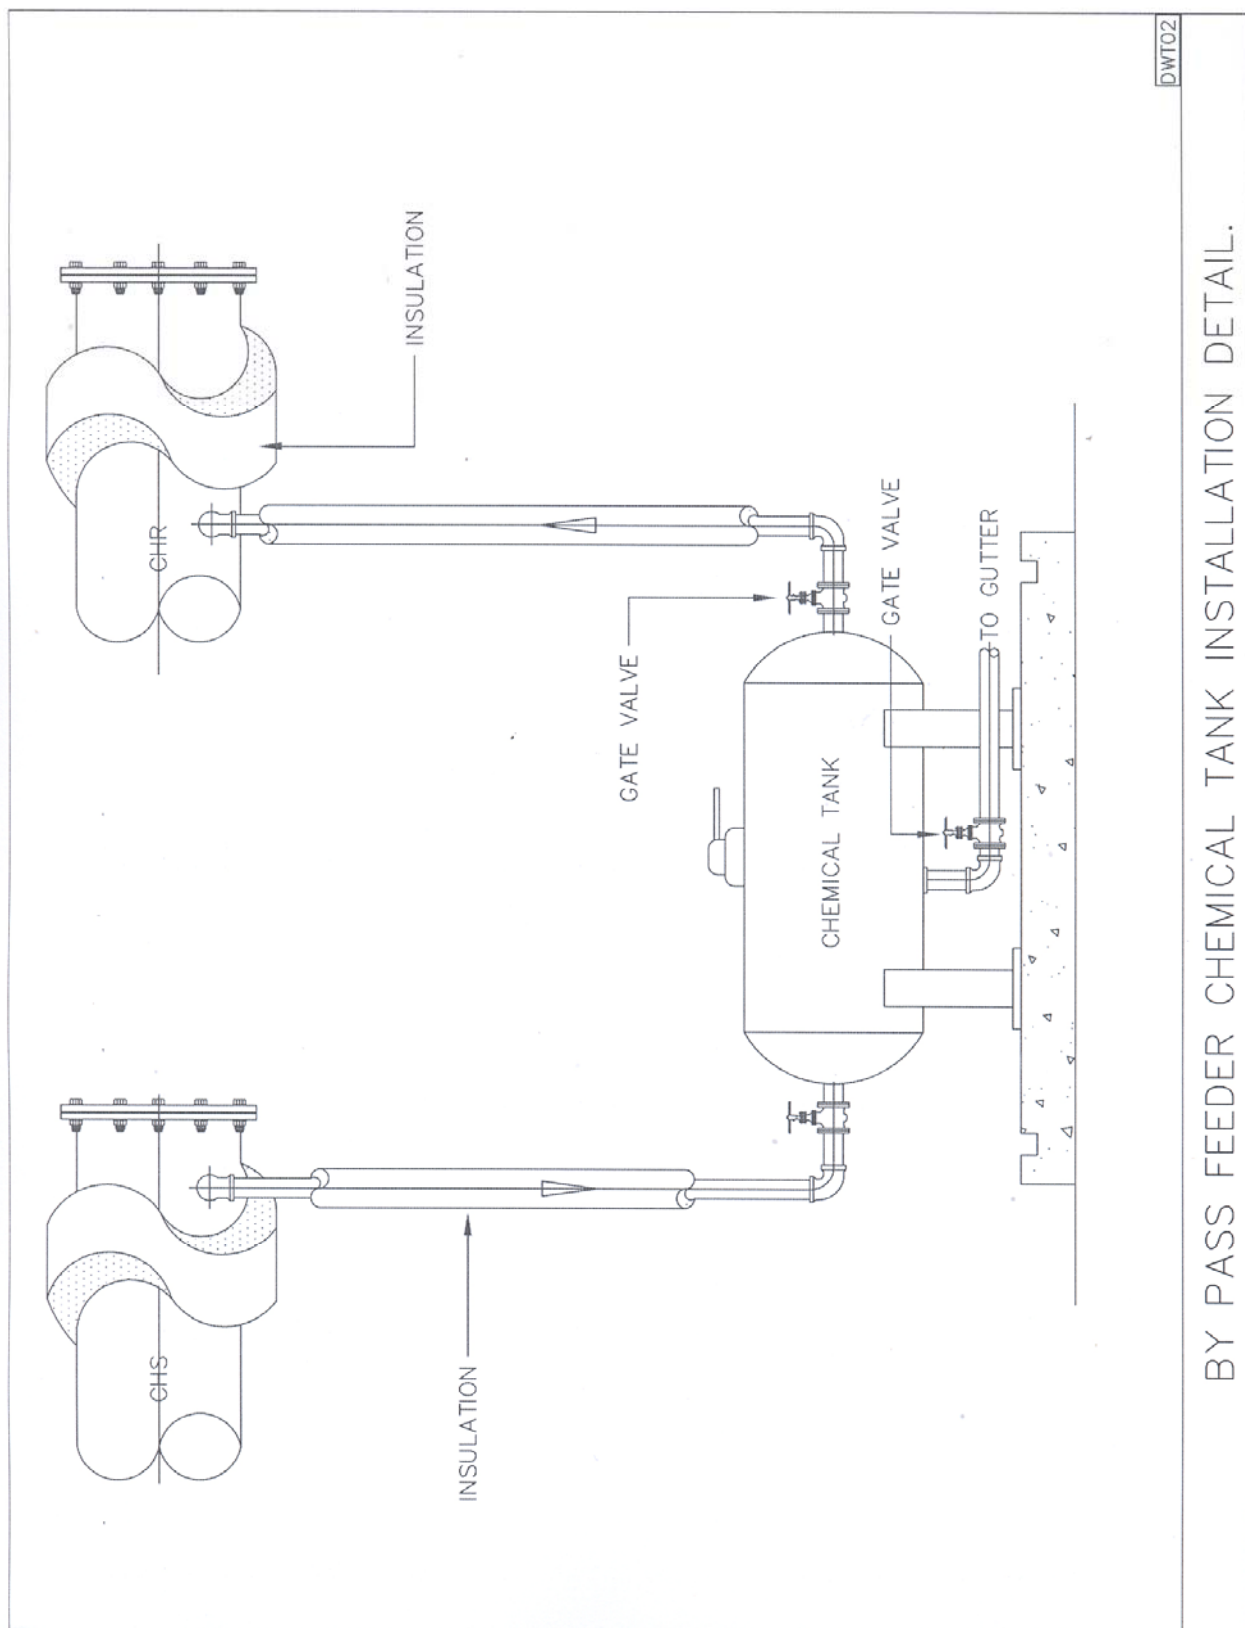

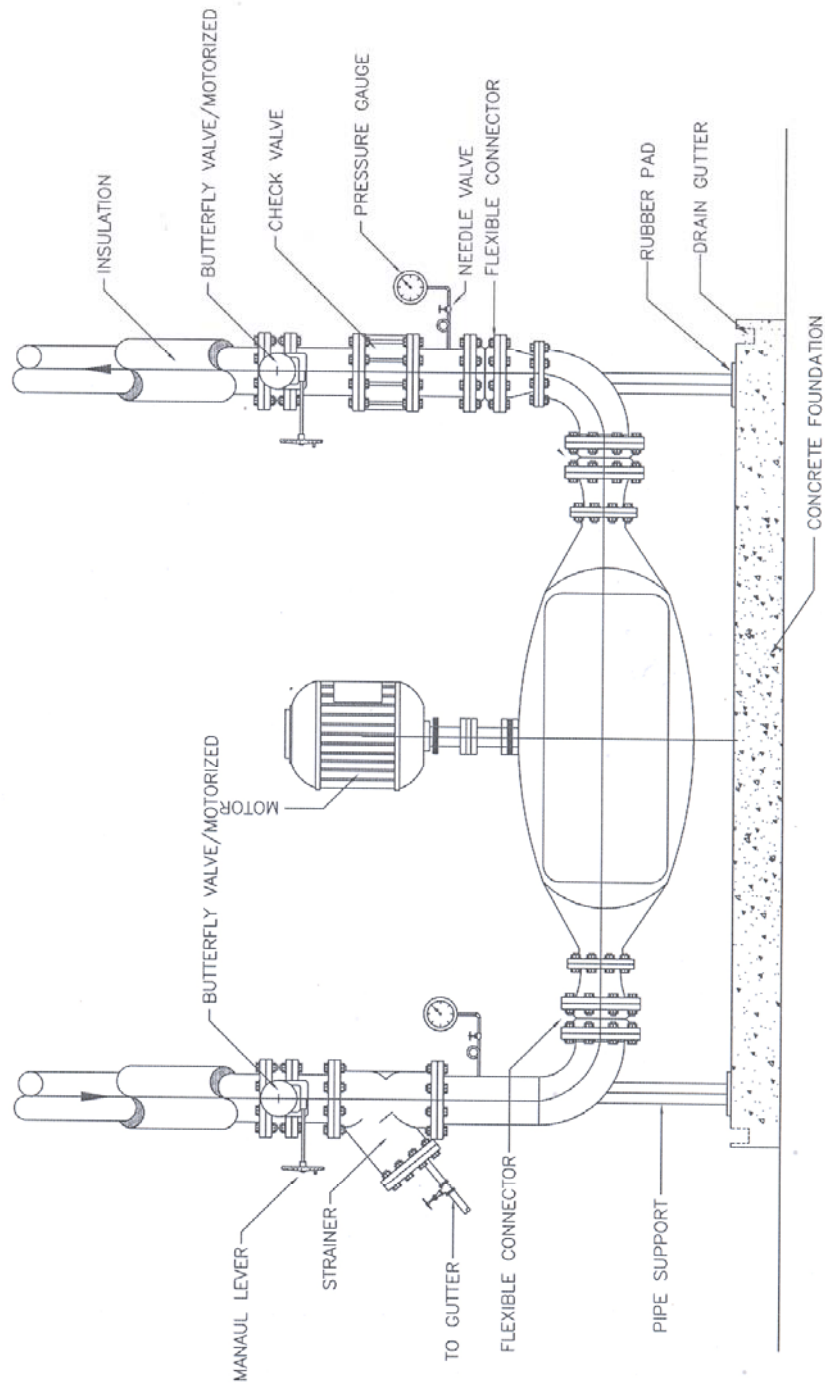

DWP02

VERTICAL IN LINE SPLIT COUPLING PUMP

หมวดงานมัณฑนาการ

